

APPROVED	0.6. FIG.
BY	CLASS
DRAFTSMAN	SUBCLASS

1/4

Percent Immunoreactivity of NCAM 75

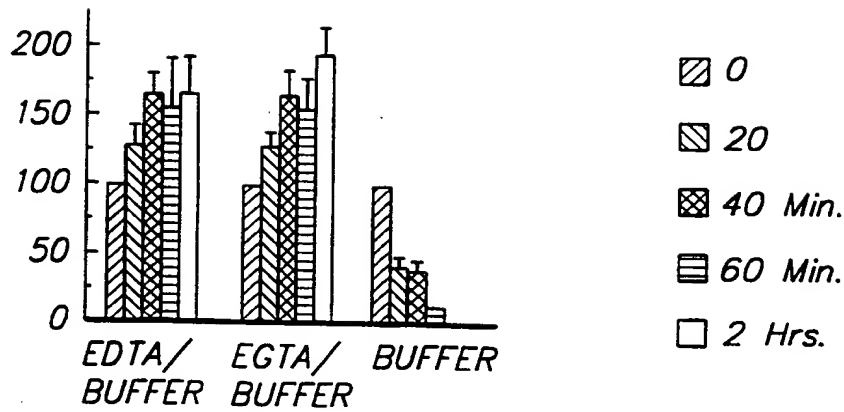


FIG. 1

Percent Immunoreactivity of CAM 75

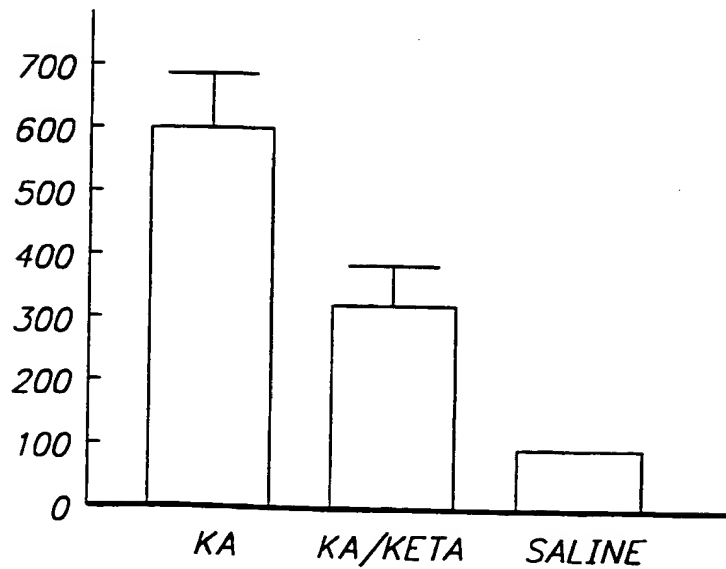


FIG. 2

2/4

APPROVED	O.G. FIG.
BY	CLASS
DRAFTSMAN	SUBCLASS

Proteolytic Inhibition (%)

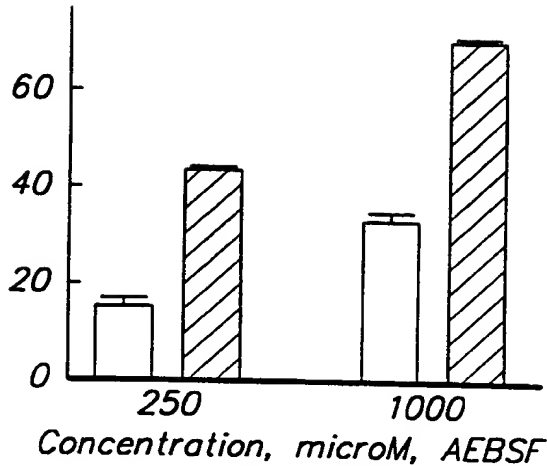


FIG. 3

Cleavage by tPa  
(fluorometric units)

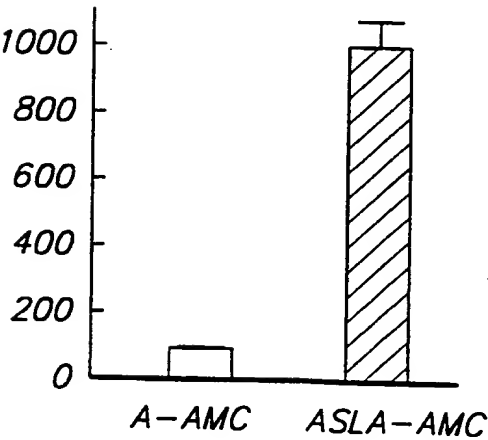


FIG. 4

3/4

APPROVED	O.G. FIG.	
BY	CLASS	SUBCLASS
DRAFTSMAN		

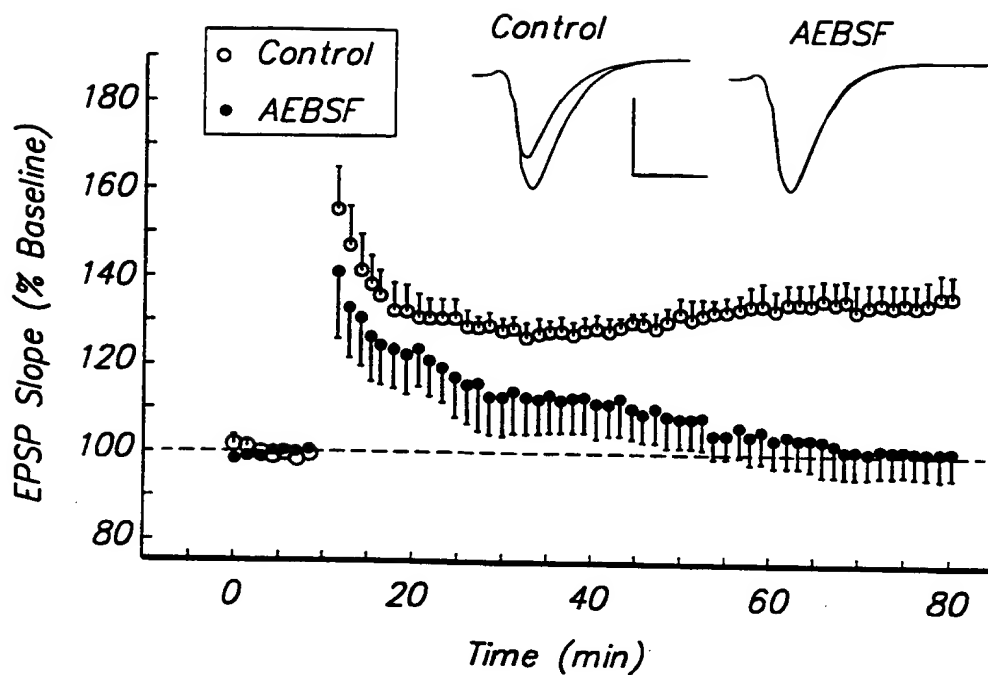


FIG. 5A

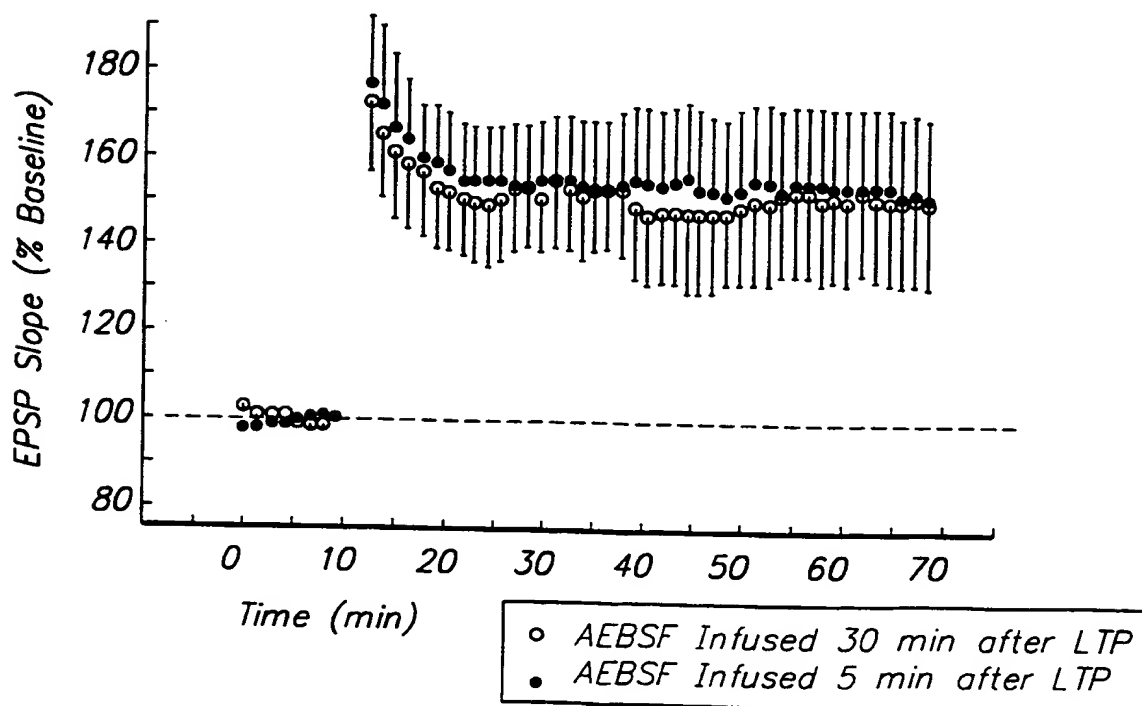


FIG. 5B

4/4

Average Seconds of After-Discharge per Stimulation

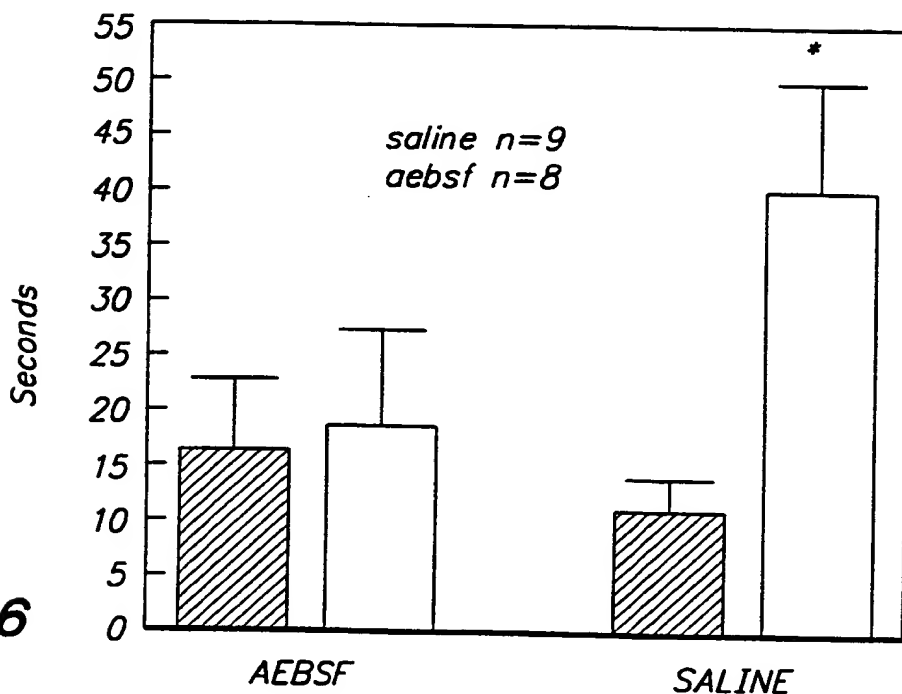


FIG. 6

Stimulation Day (hatched bars); Kindling Test Day (open bars)

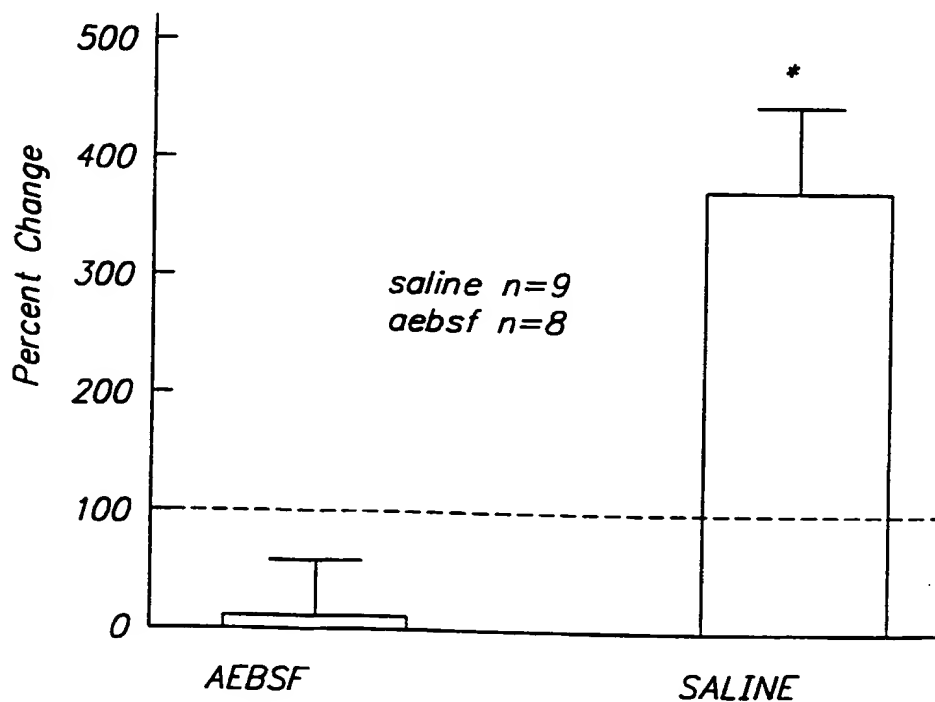


FIG. 7

Percent Change in After-Discharge Seconds per Stimulation